


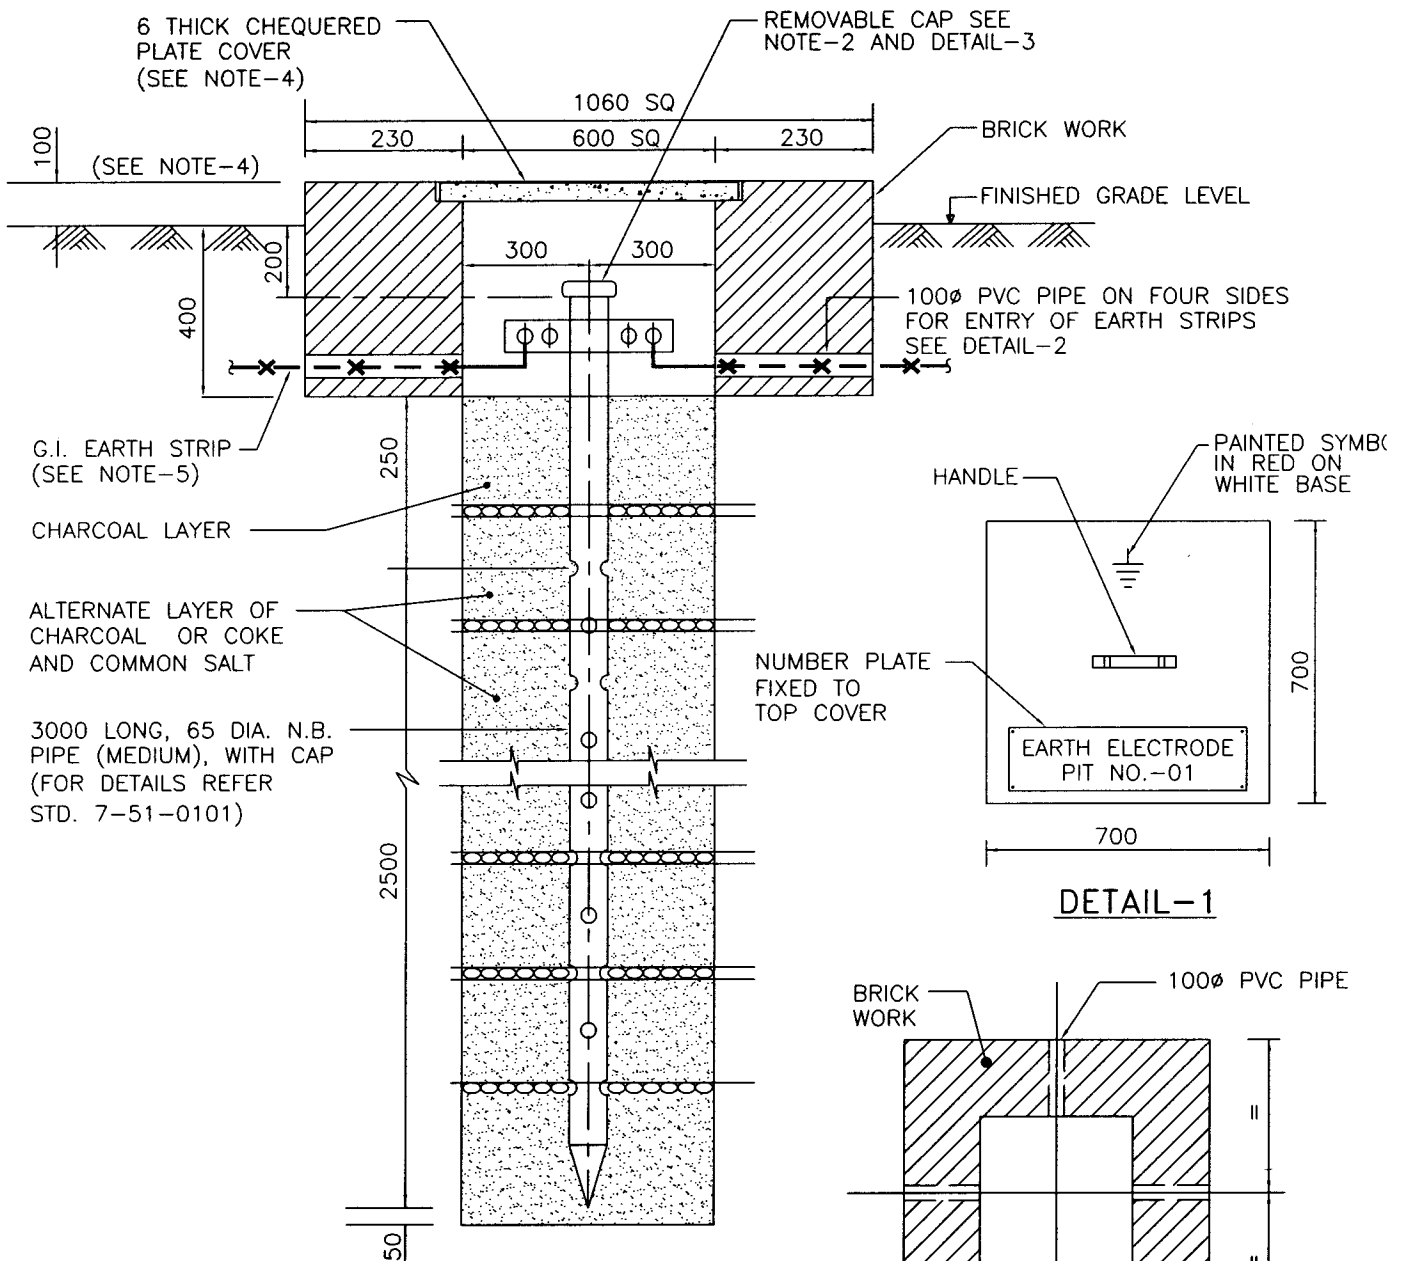

NOTES:-

1. ALL DIMENSIONS ARE IN MM.
2. BRICK WORK SHALL BE DONE AFTER COMPACTING THE SOIL.
3. AFTER REMOVAL OF CAP, OWNER SHALL BE ABLE TO POUR WATER THROUGH HIS OWN FUNNEL WITH STEEL WIRE MESH.
4. COLOUR CODING & PAINTING OF COVERS SHALL BE AS PER OISD NORMS.
5. IN CASE OF PAVED AREAS, TOP OF PIT SHALL BE FLUSHED WITH FFL, WHEREAS IN UNPAVED AREAS, TOP OF PIT SHALL BE PROJECTED 100MM ABOVE FGL.
6. CONNECTIONS OF G.I. EARTH STRIP TO THE PLATE SHALL BE IN LINE WITH STD. 7-51-0103.

5	27.06.11	REAFFIRMED & ISSUED	BP	RKS/RSC	UAP	DM
4	31.01.07	REAFFIRMED & ISSUED	BP	RKS/AKJ	JMS	VC
Rev. No.	Date	Purpose	Prepared by	Checked by	Stds. Committee Convenor	Stds. Bureau Chairman
Approved by						