



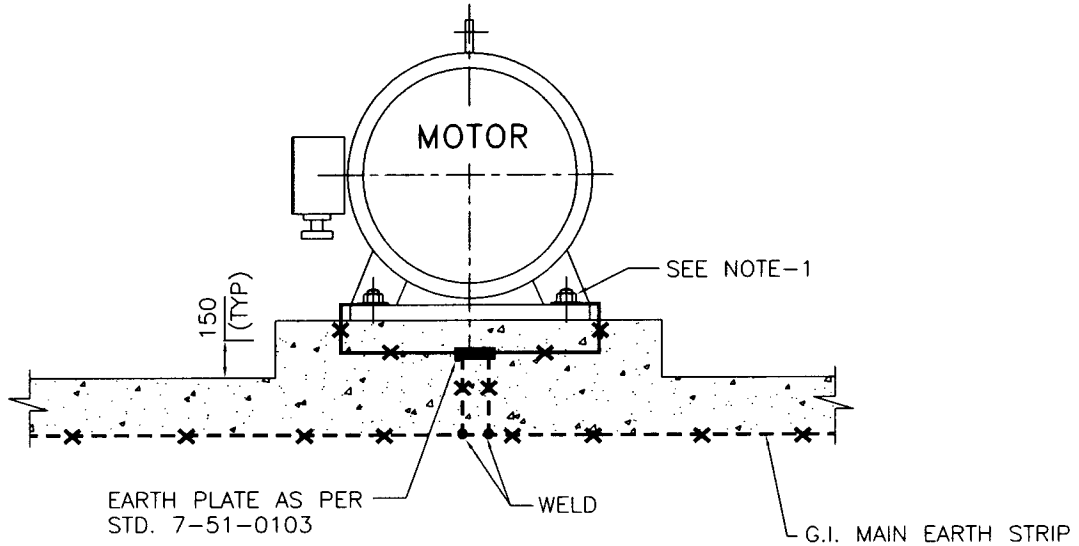

DETAIL-1
CONNECTION WITH BURIED EARTH GRID

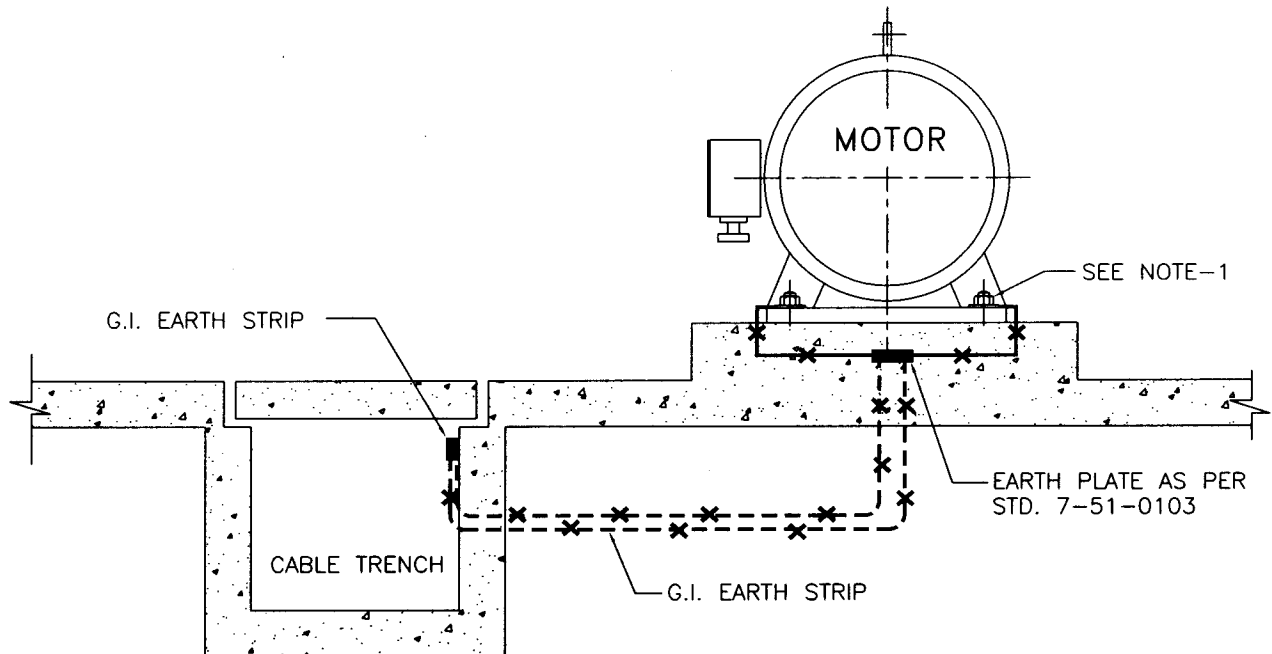

DETAIL-2
CONNECTION WITH EARTH GRID IN RCC TRENCH

NOTE:-

1. MOTOR FOUNDATION BOLT SHALL NOT BE USED FOR EARTHING.
2. EARTHING OF P.B. STN. INSTALLED NEAR MOTOR FOUNDATION SHALL BE DONE BY TAPPING 8 SWG G.I. WIRE FROM EARTH PLATE.

4	27.06.11	REAFFIRMED & ISSUED	BP	RKS/RSC	UAP	DM
3	31.01.07	REAFFIRMED & ISSUED	BP	RKS/AKJ	JMS	VC
Rev. No.	Date	Purpose	Prepared by	Checked by	Stds. Committee Convenor	Stds. Bureau Chairman
			Approved by			