


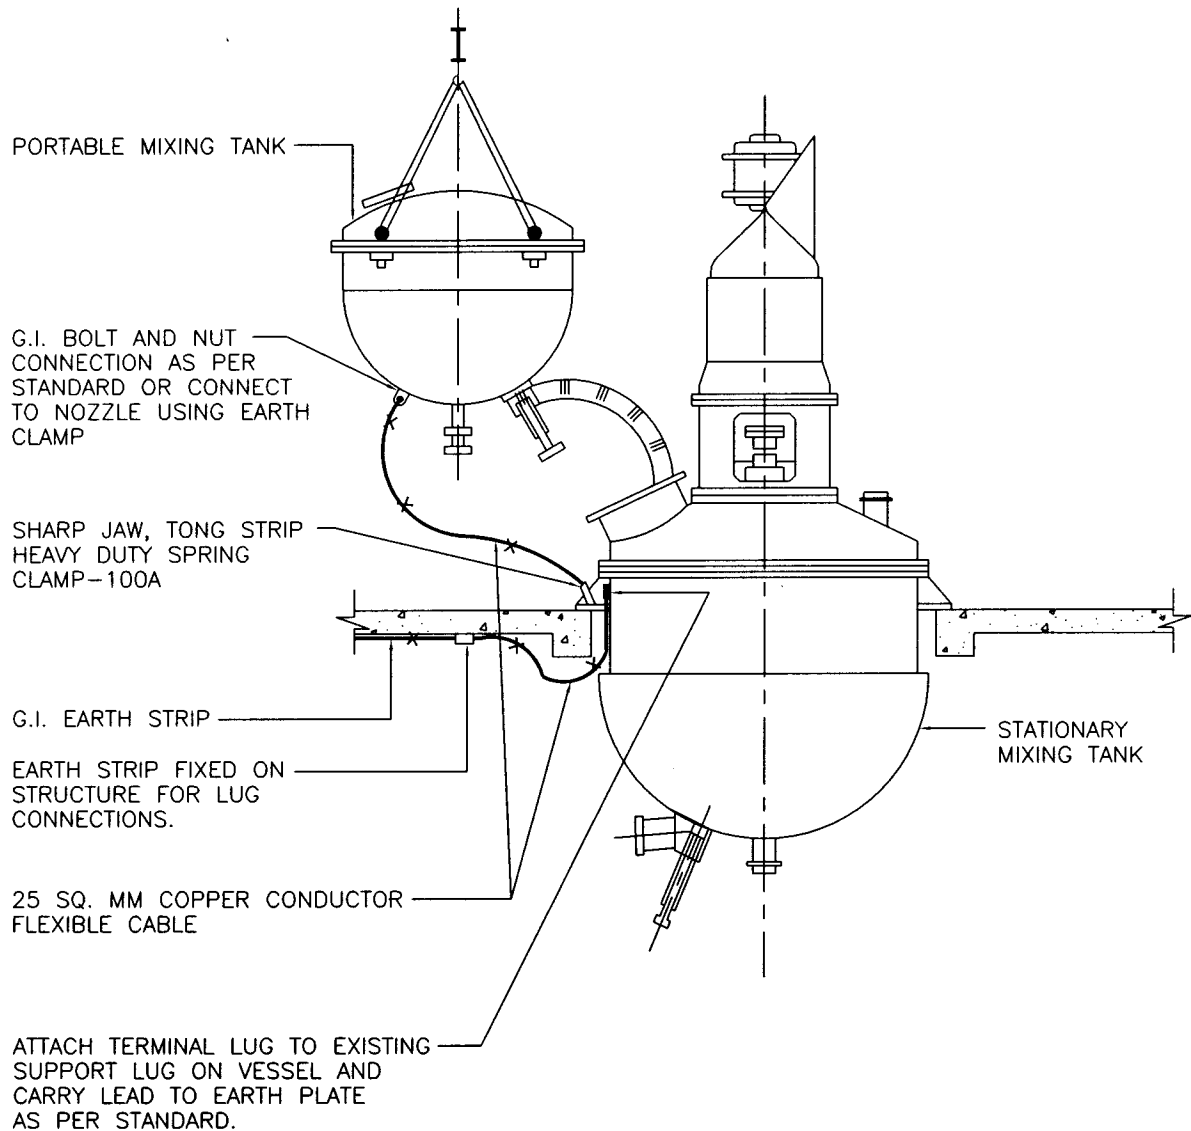

NOTE:-

1. ALL PROCESSING EQUIPMENT SUCH AS MIXTURES, CHURNS, AUTOCLAVES, COLUMNS, CENTRIFUGES, FILTERS, PRESS PUMPS ETC. SHALL BE EARTHED, IF THESE ARE NOT IN DIRECT CONTACT WITH PROPERLY EARTHED STEEL MEMBERS.
2. ALL TEMPORARY EARTH CONNECTIONS SHALL BE MADE BEFORE OPENING THE VESSEL

4	27.06.11	REAFFIRMED & ISSUED	BP	RKS/RSC	UAP	DM
3	31.01.07	REAFFIRMED & ISSUED	BP	RKS/AKJ	JMS	VC
Rev. No.	Date	Purpose	Prepared by	Checked by	Stds. Committee Convenor	Stds. Bureau Chairman
Approved by						