




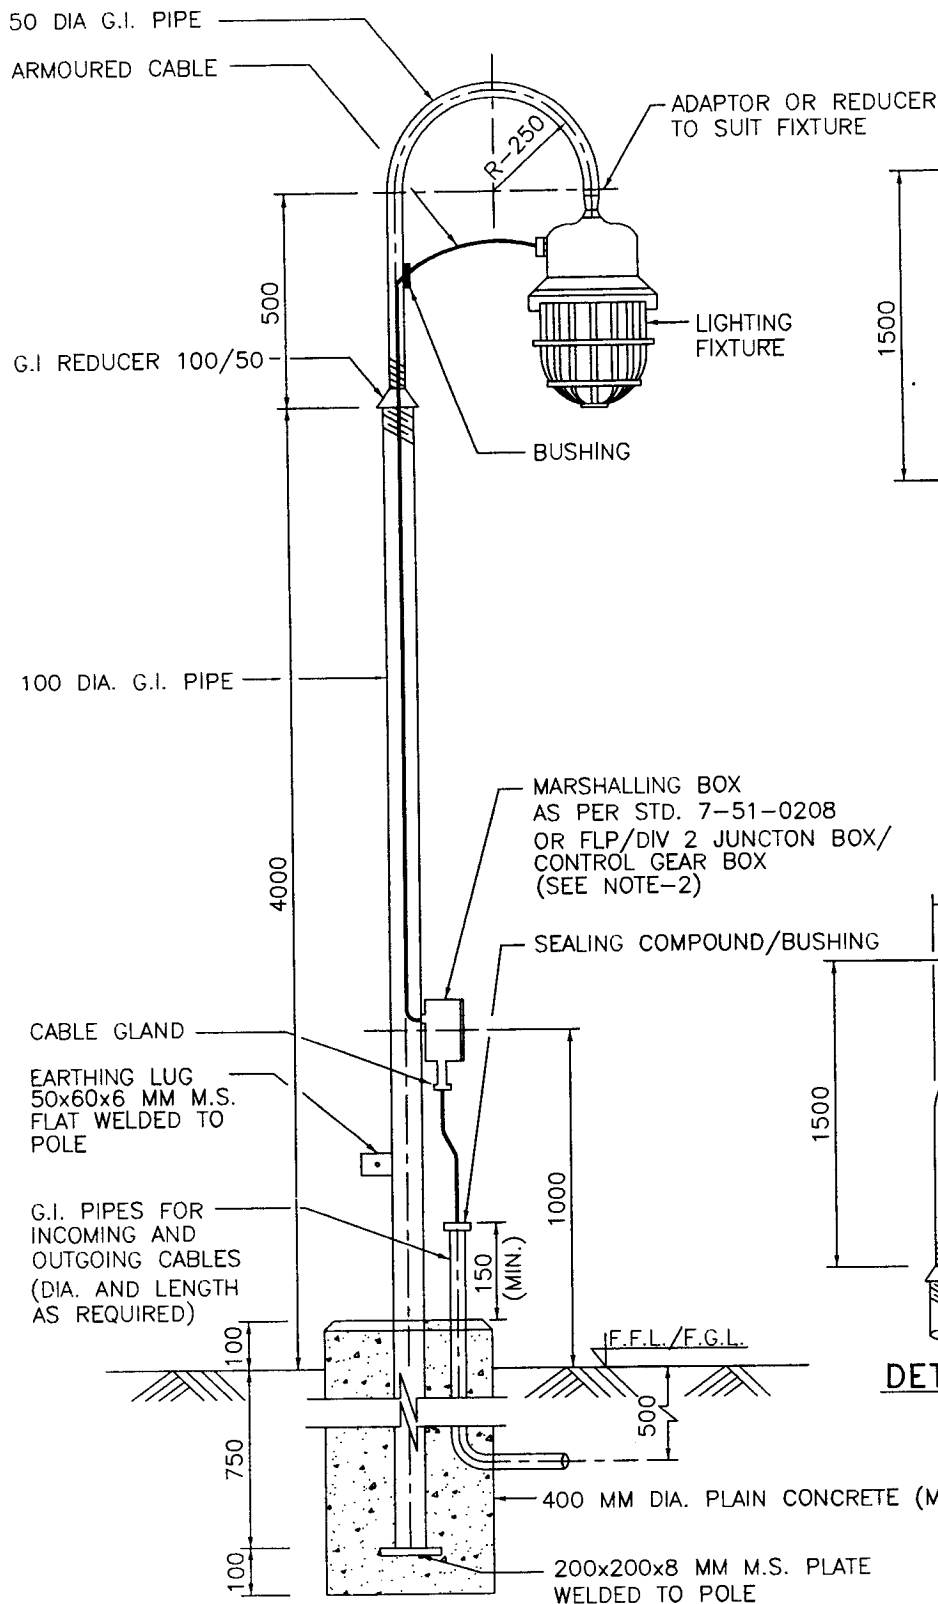

DETAIL-1

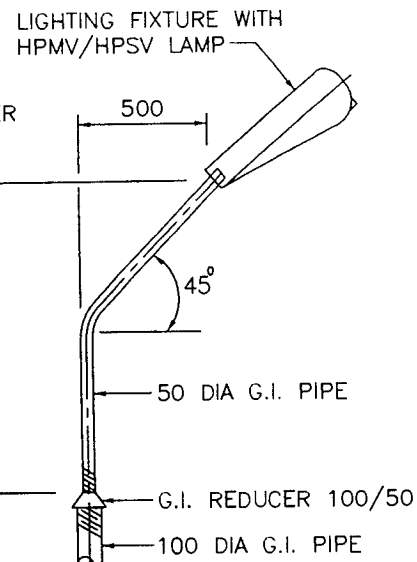

DETAIL-2

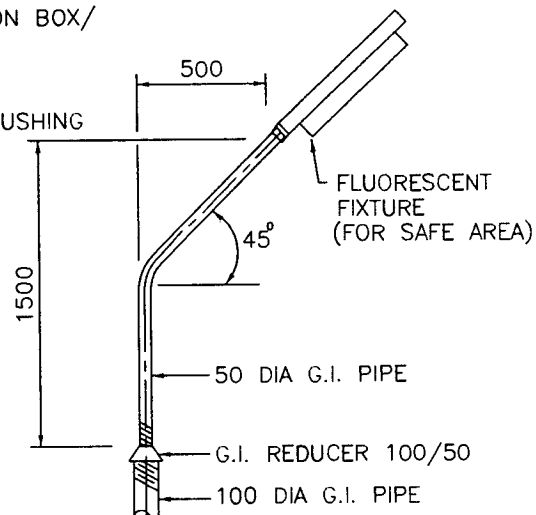

DETAIL-3

NOTES:-

1. ALL DIMENSIONS ARE IN MM.
2. MARSHALLING BOX, JUNCTION BOX AND G.I. PIPES FOR CABLES SHALL BE LOCATED FACING CABLE TRENCH SIDE.
3. ALL G.I. PIPES SHALL BE MEDIUM GRADE.

4	17.07.13	REAFFIRMED & ISSUED AS STANDARD	BP	FA/SA	UAP/JMS	DM
3	15.12.08	REAFFIRMED & ISSUED AS STANDARD	BP	RKS/NS	JMS	VC
Rev. No.	Date	Purpose	Prepared by	Checked by	Stds. Committee Convenor	Stds. Bureau Chairman
Approved by						