


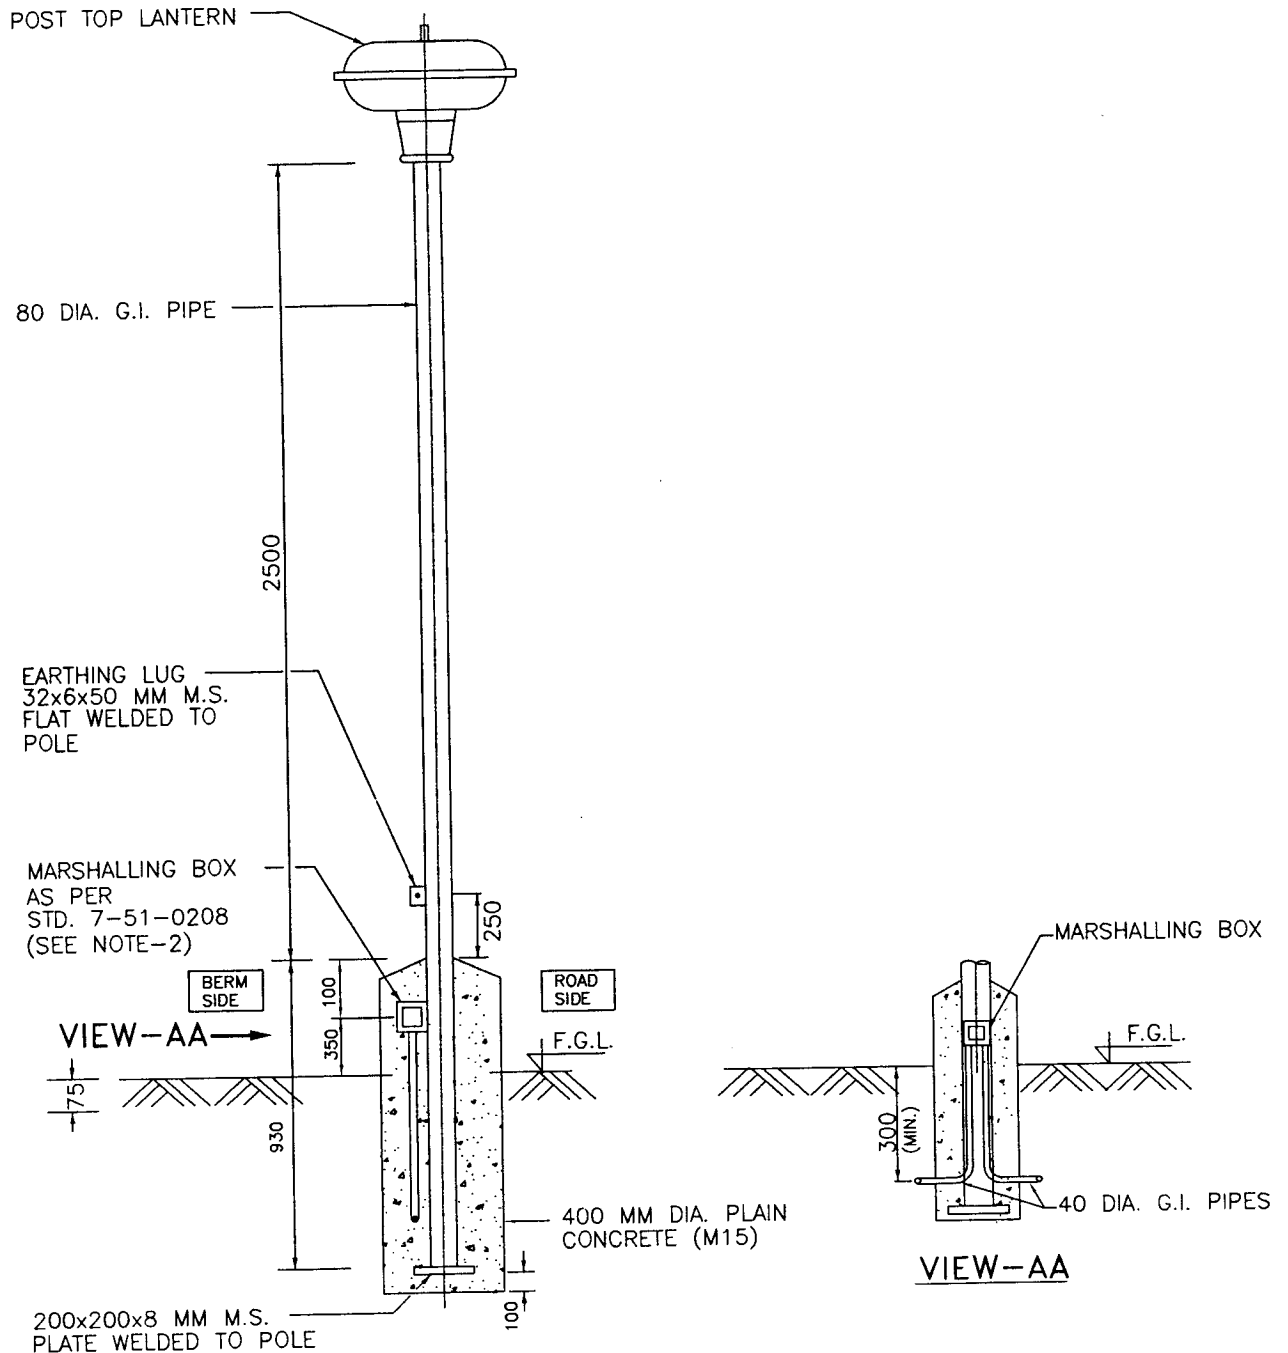

NOTES:-

1. ALL DIMENSIONS ARE IN MM.
2. USE WEATHER PROTECTED SINGLE PHASE JUNCTION BOX IN PLACE OF MARSHALLING BOX IF SUPPLY IS SINGLE PHASE.
3. ALL G.I. PIPES SHALL BE MEDIUM GRADE.

Rev. No.	Date	Purpose	Prepared by	Checked by	Std. Committee Convenor	Std. Bureau Chairman
4	17.07.13	REAFFIRMED & ISSUED AS STANDARD	BP	FA/SA	UAP/JMS	DM
3	15.12.08	REAFFIRMED & ISSUED AS STANDARD	BP	RKS/NS	JMS	VC
Approved by						