
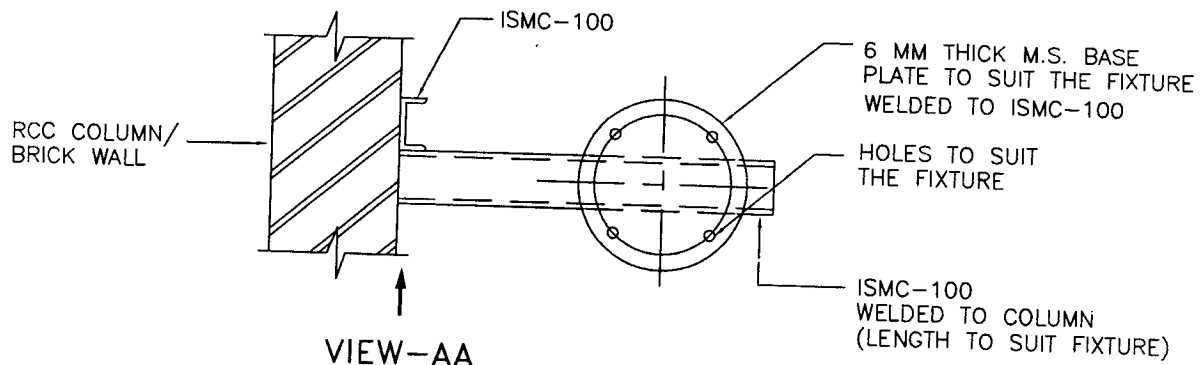
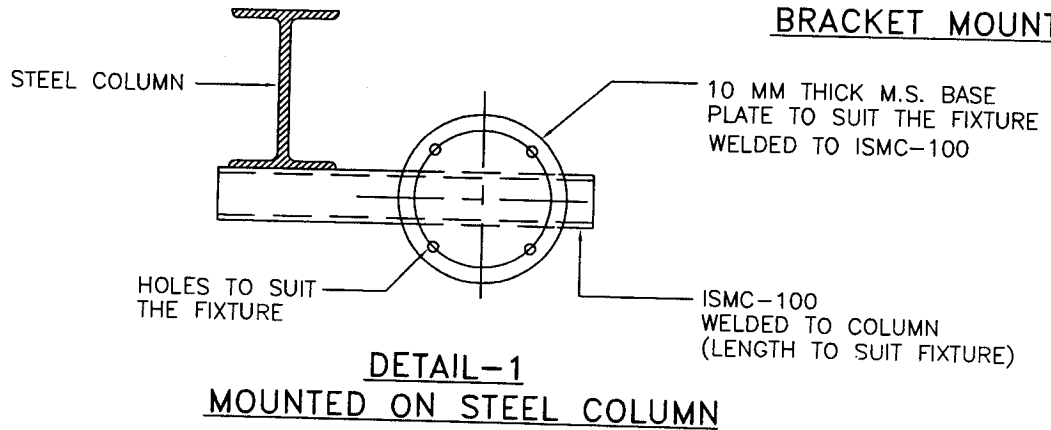


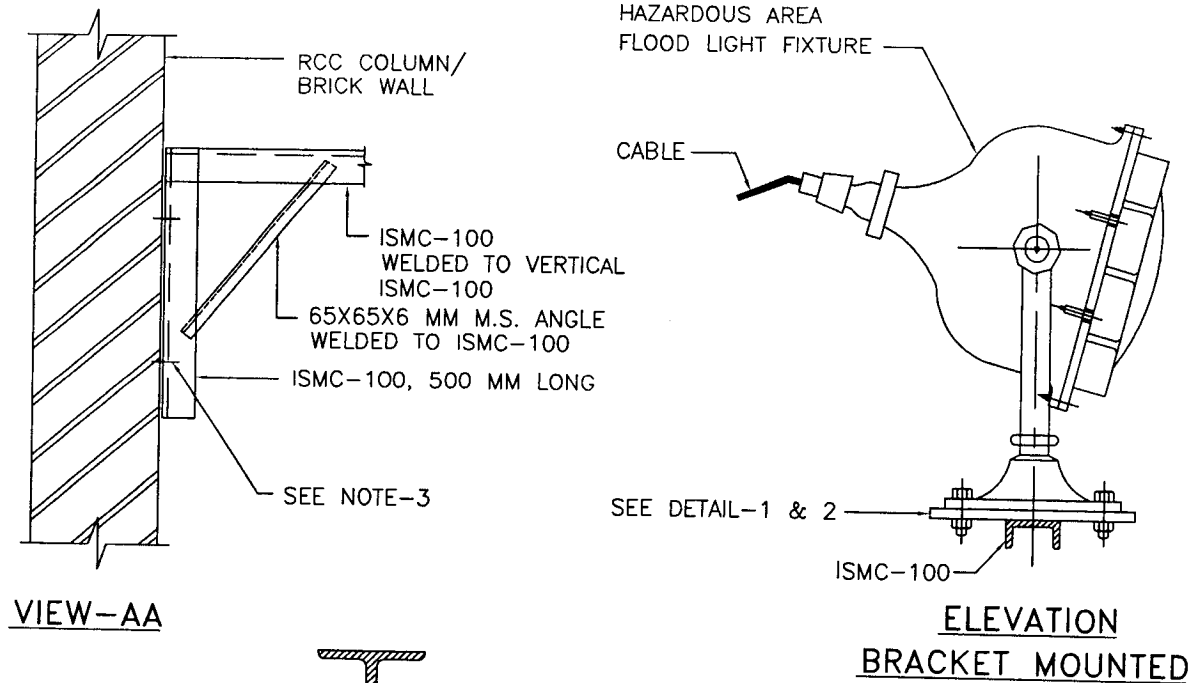

NOTES:-

1. ALL DIMENSIONS ARE IN MM.
2. WHERE FIRE PROOFING COLUMNS / STRUCTURES ARE ENCOUNTERED RECEPTACLE, JUNCTION BOX AND CABLE SHALL BE INSTALLED ON A SUITABLE DEEP LEGGED ANGLE IRON FRAME / DISTANCE BRACKET.
3. SUPPORT FOR FLOOD LIGHT FIXTURE SHALL BE SUITABLY FIXED TO RCC COLUMN/ BRICK WALL BY USING ANCHOR FASTENER.

4	17.07.13	REAFFIRMED & ISSUED AS STANDARD	BP	FA/SA	UAP/JMS	DM
3	15.12.08	REVISED & ISSUED AS STANDARD	BP	RKS/NS	JMS	VC
Rev. No.	Date	Purpose	Prepared by	Checked by	Stds. Committee Convenor	Stds. Bureau Chairman
Approved by						
Copyright EIL - All rights reserved						