



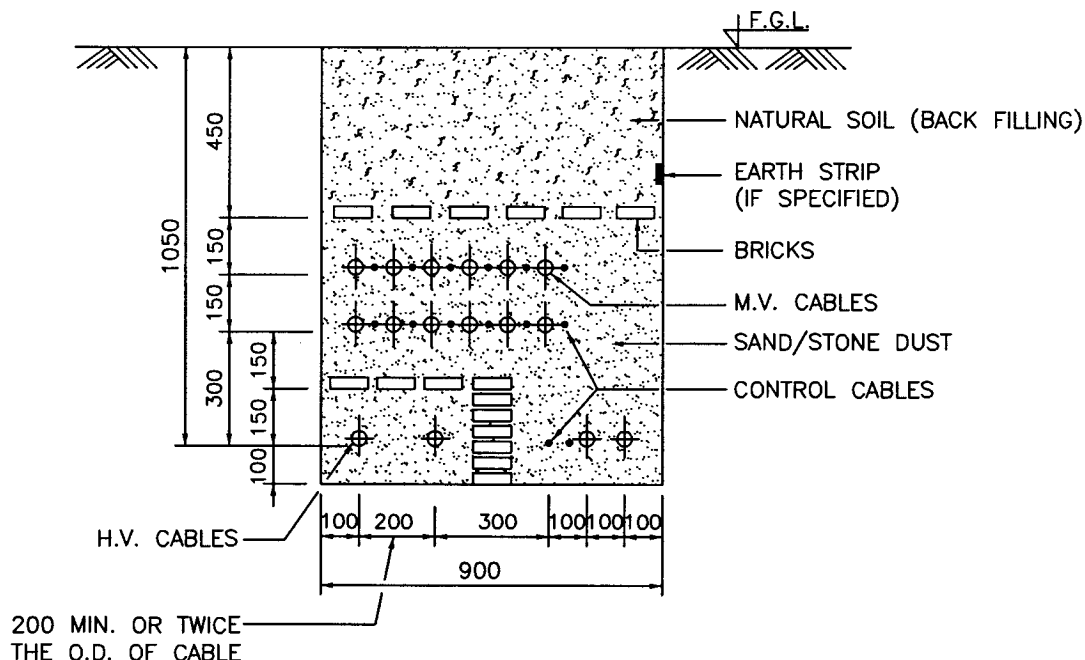

TYPICAL SECTION WITH H.V. AND M.V. CABLES

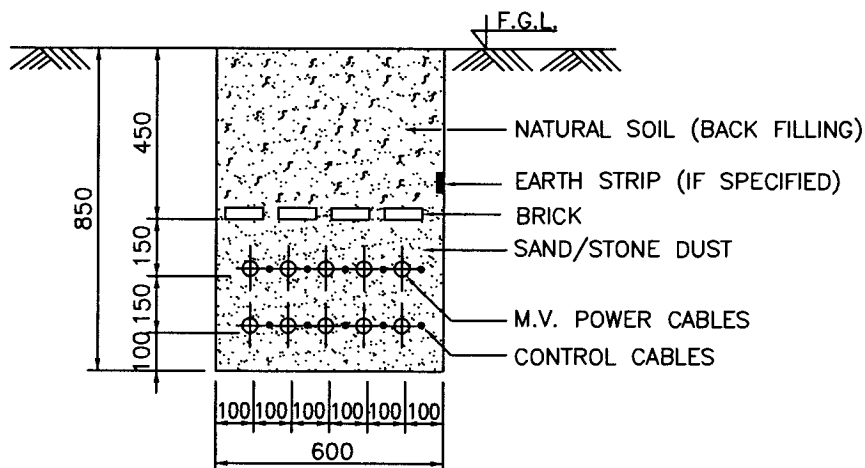

TYPICAL SECTION WITH M.V. CABLES

NOTES:—

1. ALL DIMENSIONS ARE IN MM.
2. LEAVE SPACE FOR LATER ADDITION OF AT LEAST 2 CABLES OR 15% AVERAGE SPARE SPACE FOR FUTURE EXPANSION.
3. IF FIRE ALARM AND COMMUNICATION CABLES ARE LAID IN THE SAME TRENCH A CLEARANCE OF 300 MM (MIN.) FROM ELECTRIC POWER CABLES SHALL BE PROVIDED.

4	21.11.13	REVISED & REISSUED AS STANDARD	BP	FA/SA	UAP/JMS	SC
3	15.12.08	REAFFIRMED & ISSUED AS STANDARD	BP	RKS/NS	JMS	VC
Rev. No.	Date	Purpose	Prepared by	Checked by	Stds. Committee Convenor	Stds. Bureau Chairman