


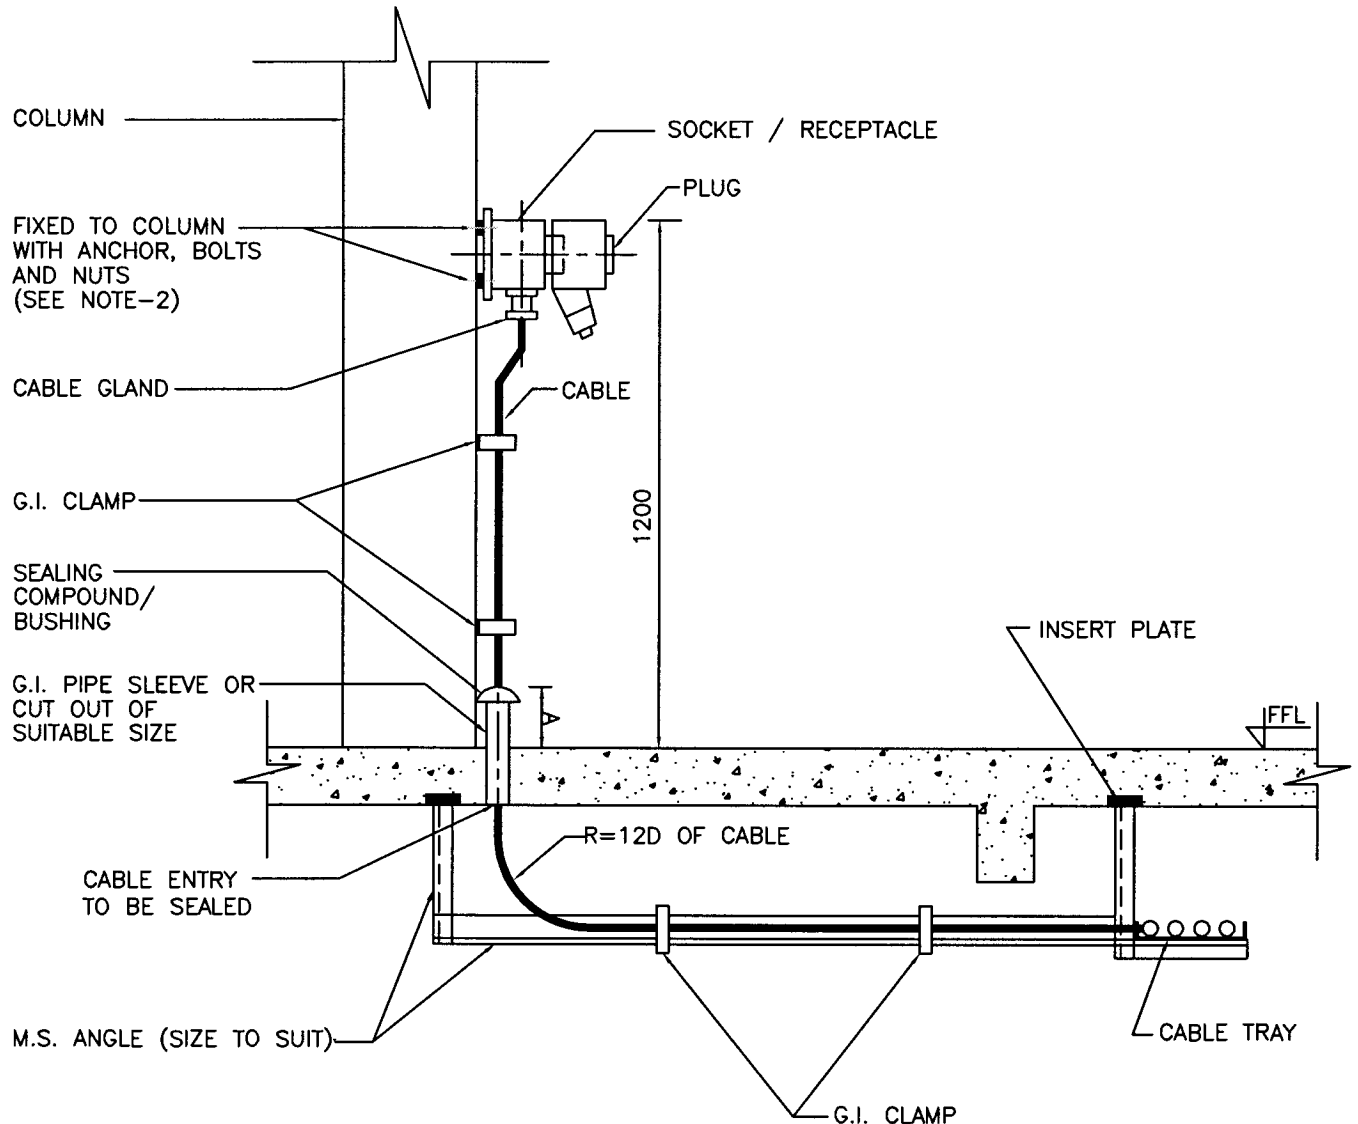

NOTES:—

1. ALL DIMENSIONS ARE IN MM.
2. WHERE STEEL STRUCTURES ARE ENCOUNTERED, SOCKET / RECEPTACLE SHALL BE MOUNTED ON SUITABLE ANGLE IRON FRAME WELDED TO STEEL STRUCTURE.
3. WHERE FIRE PROOFING COLUMNS / STRUCTURES ARE ENCOUNTERED SOCKET / RECEPTACLE AND CABLE SHALL BE INSTALLED ON A SUITABLE DEEP LEGGED ANGLE IRON FRAME / DISTANCE BRACKET.

4	21.11.13	REAFFIRMED & ISSUED AS STANDARD	BP	FA/SA	UAP/JMS	SC
3	13.02.09	REAFFIRMED & ISSUED AS STANDARD	BP	RKS/NS	JMS	VC
Rev. No.	Date	Purpose	Prepared by	Checked by	Stds. Committee Convenor	Stds. Bureau Chairman