



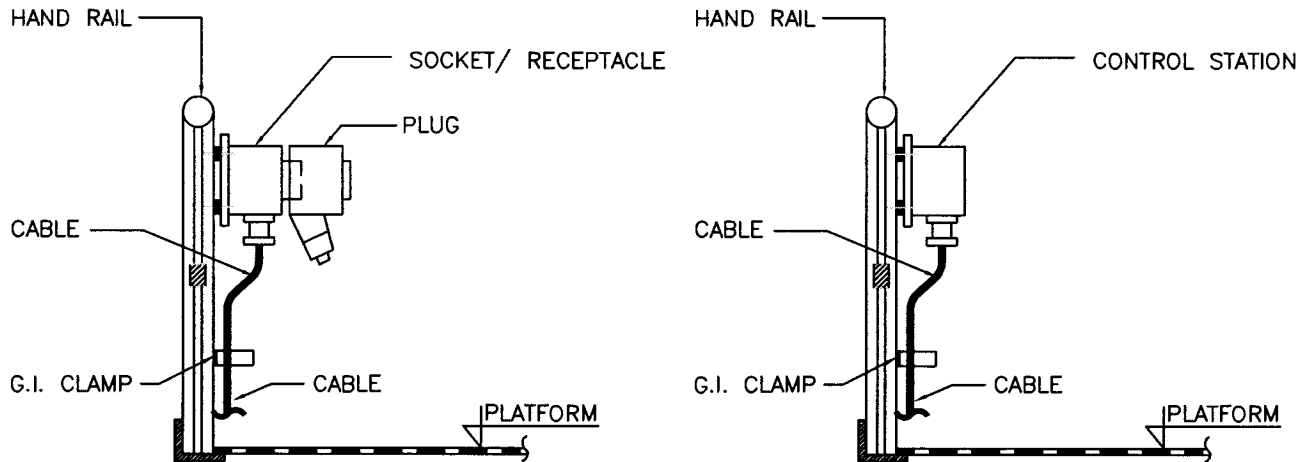

HOLE TO BE DRILLED ON
50x6 M.S. FLATS TO MATCH
WITH THOSE ON SOCKET /
RECEPTACLE / CONTROL STATION

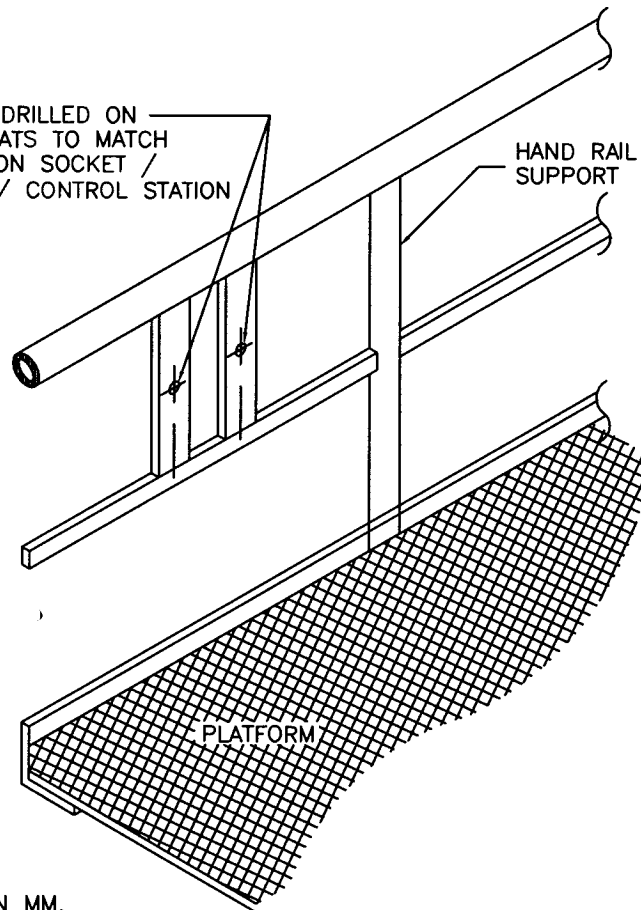

NOTES:—

1. ALL DIMENSIONS ARE IN MM.
2. CABLE SHALL NOT BE ROUTED ALONG HAND RAIL.

4	21.11.13	REVISED & REISSUED AS STANDARD	BP	FA/SA	UAP/JMS	SC
3	13.02.09	REAFFIRMED & ISSUED AS STANDARD	BP	RKS/NS	JMS	VC
Rev. No.	Date	Purpose	Prepared by	Checked by	Stds. Committee Convenor	Stds. Bureau Chairman