


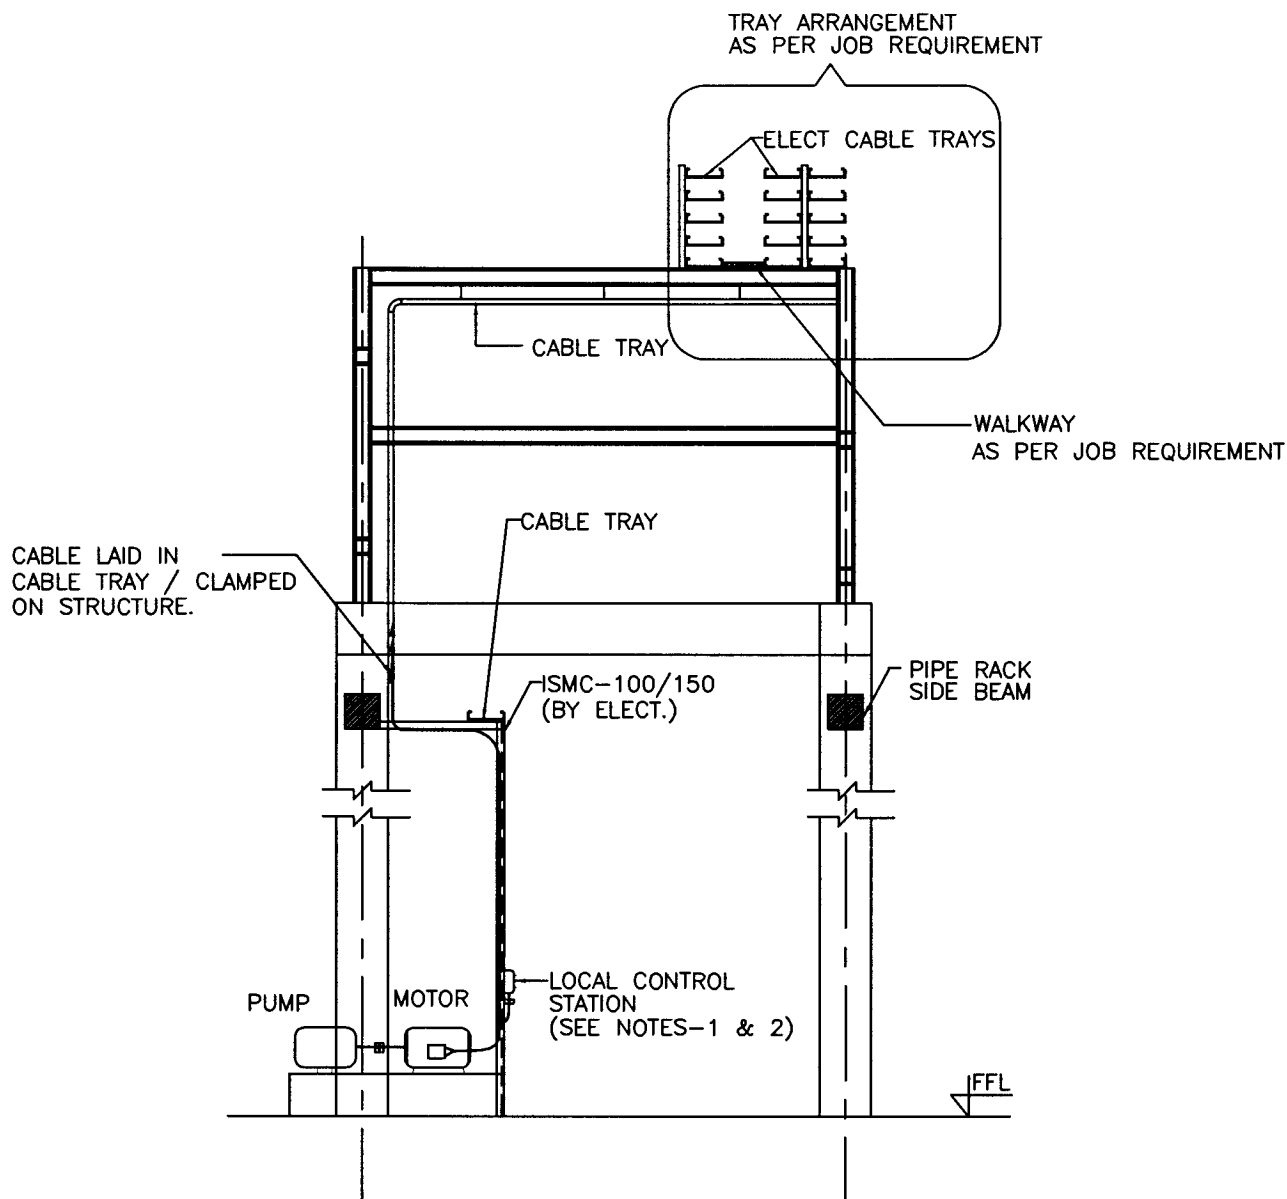

NOTES:—

1. LOCATION OF SUPPORT FOR LOCAL CONTROL STATION SHALL BE SUITABLY DECIDED AT SITE DEPENDING UPON THE BENDING RADIUS OF CABLE.
2. HEIGHT OF CONTROL STATION SUPPORT SHALL BE 3.5 M OR UPTO THE PIPE RACK SIDE BEAM WHICHEVER IS LOWER.

3	21.11.13	REVISED & REISSUED AS STANDARD	BP	FA/SA	UAP/JMS	SC
2	13.02.09	REAFFIRMED & ISSUED AS STANDARD	BP	RKS/NS	JMS	VC
Rev. No.	Date	Purpose	Prepared by	Checked by	Std. Committee Convenor	Std. Bureau Chairman
Approved by						