


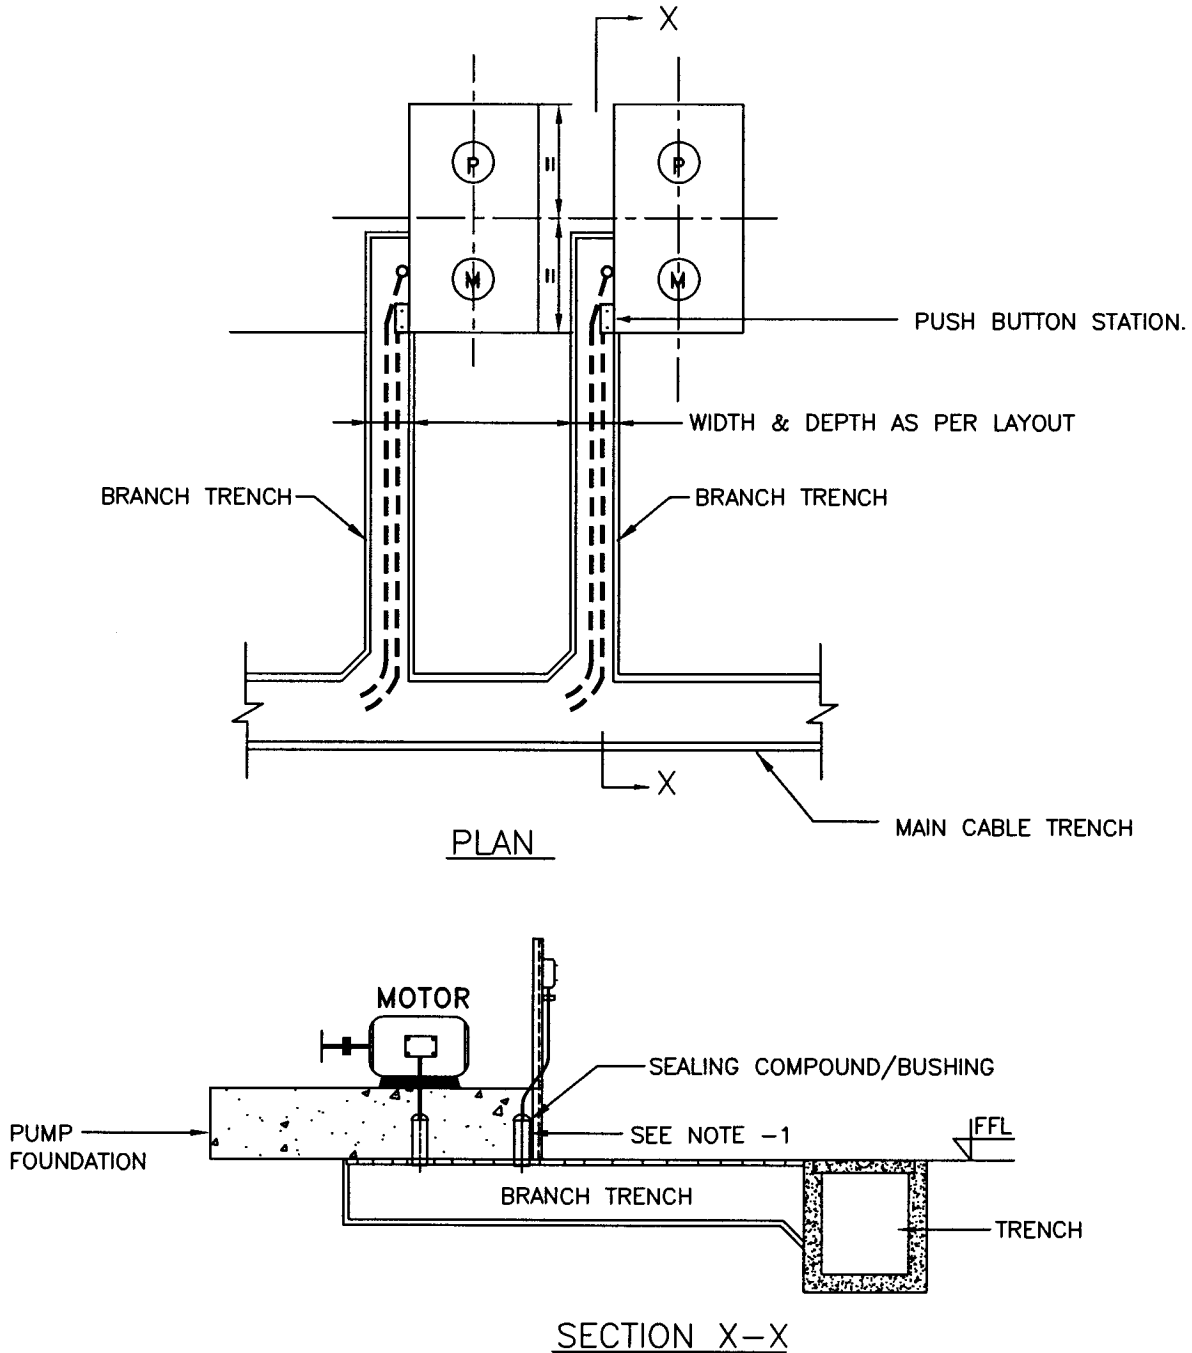

NOTES:—

1. CABLE SHALL BE LAID IN SUITABLE SIZE OF G.I. PIPES .
2. CABLE TRENCH SHALL BE FILLED WITH SAND AFTER LAYING OF CABLES IN HAZARDOUS AREA (BY THE ELECTRICAL CONTRACTOR.)

3	21.11.13	REVISED & REISSUED AS STANDARD	BP	FA/SA	UAP/JMS	SC
2	13.02.09	REAFFIRMED & ISSUED AS STANDARD	BP	RKS/NS	JMS	VC
Rev. No.	Date	Purpose	Prepared by	Checked by	Std. Committee Convenor	Std. Bureau Chairman