


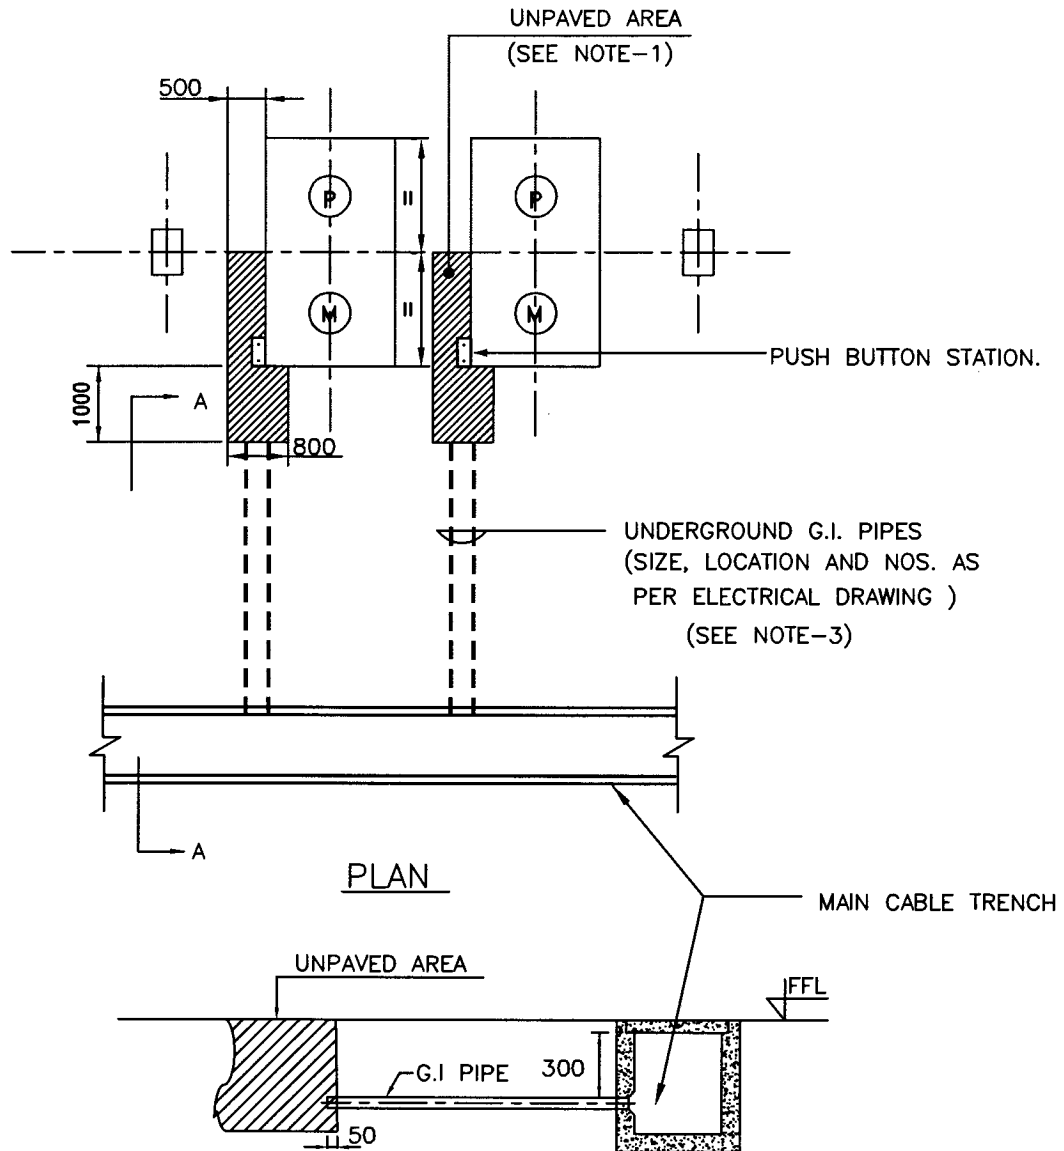

SECTION A-A

NOTES:-

1. AREA AS SHOWN HATCHED NEAR EACH PUMP FOUNDATION SHALL BE LEFT UNPAVED BY PAVEMENT CONTRACTOR.
2. CABLES LAYING & SAND / LEAN CONCRETE FILLING ON TOP OF CABLES SHALL BE DONE BY ELECTRICAL CONTRACTOR.
3. CIVIL CONTRACTOR SHALL PROVIDE G.I PIPES AND PLUG BOTH ENDS OF THE PIPES WITH PVC BUSHINGS.

3	21.11.13	REVISED & REISSUED AS STANDARD	BP	FA/SA	UAP/JMS	SC
2	13.02.09	REAFFIRMED & ISSUED AS STANDARD	BP	RKS/NS	JMS	VC
Rev. No.	Date	Purpose	Prepared by	Checked by	Stds. Committee Convenor	Stds. Bureau Chairman
Approved by						