



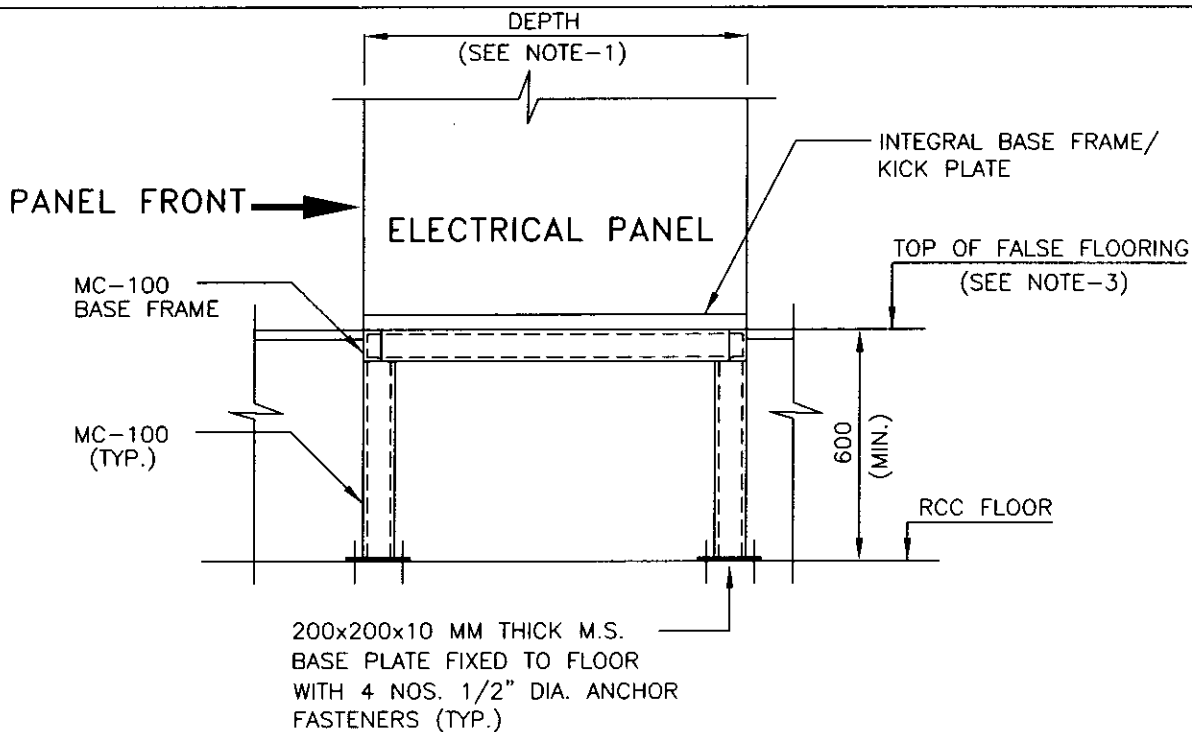

ELEVATION
(VIEW-A)

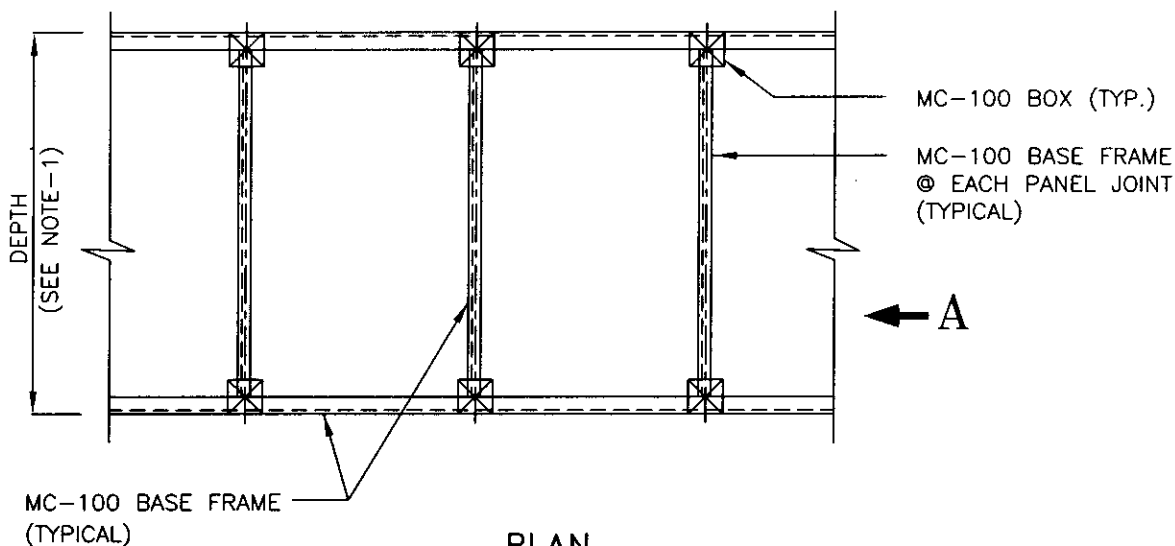

PLAN

NOTES:-

1. FOR PANELS DEPTH UPTO 800 MM SUPPORTING ARRANGEMENT AS SHOWN SHALL BE FOLLOWED. FOR PANELS DEPTH MORE THAN 800 MM ADDITIONAL SUPPORTS AS PER VENDOR'S FDN. PLAN SHALL BE PROVIDED.
2. ALL PANELS SHALL BE TACK WELDED WITH BASE FRAME OF SWITCHBOARD.
3. SUPPORTING ARRANGEMENT FOR FALSE FLOORING SHALL BE AS PER ARCHITECTURAL DRAWINGS.

2	02.03.12	REAFFIRMED & ISSUED	BP	RKS/RSC	UAP/JMS	DM
1	26.09.06	REVISED AND REISSUED	BP	RKS/UAP	JMS	VC
Rev. No.	Date	Purpose	Prepared by	Checked by	Stds. Committee Convenor	Stds. Bureau Chairman
Approved by						